




# Three-Compartment Sink

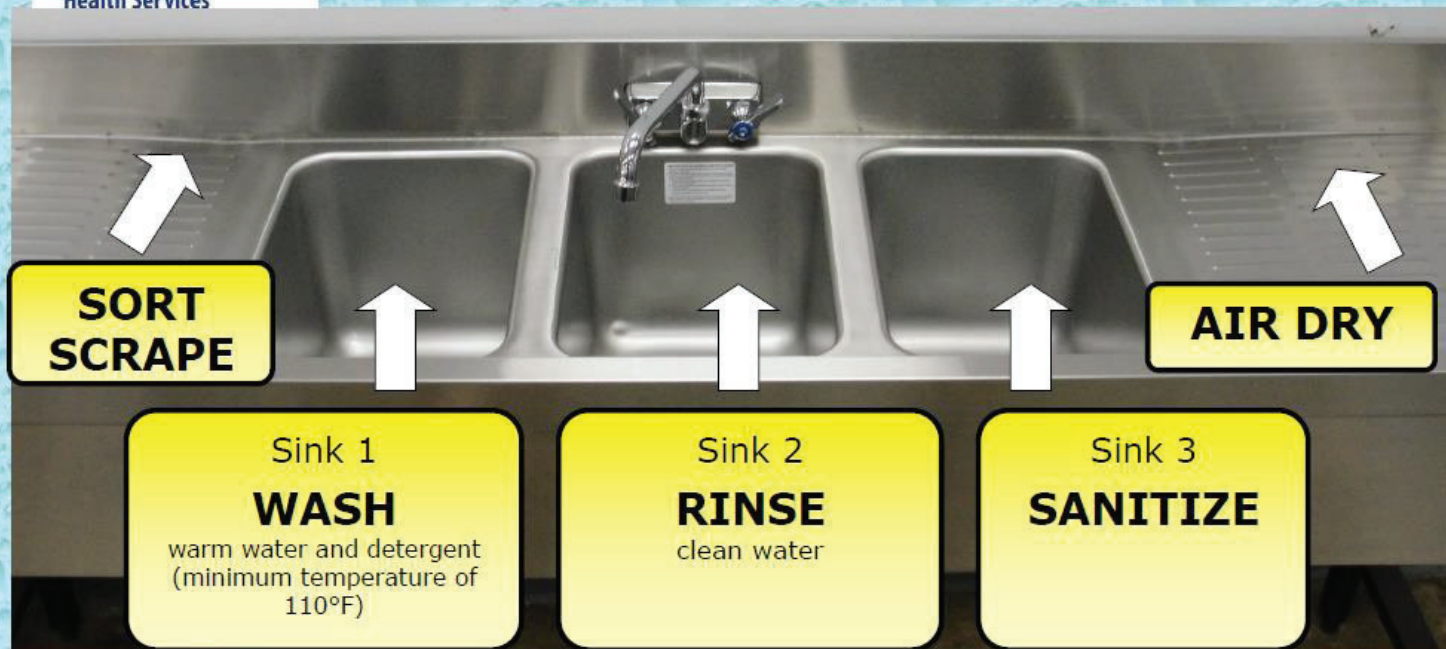

## HOW TO SANITIZE

### Chlorine Solution

- minimum temperature 75°F - 100°F
- 7-10 seconds in 25 - 100 ppm

### Quaternary Ammonium Solution

- minimum temperature 75°F
- 30 seconds in 200 - 400 ppm

### Iodine Solution

- minimum temperature 75°F
- 30 seconds in 12.5 - 25 ppm

*All chemical solutions should be tested for effectiveness using a test kit strip. Use according to manufacturer's directions and the Texas Food Establishment Rules*

Publication # EH-26 2/17